






REVERSOMATIC
MANUFACTURING LIMITED

HRV/ERV INTAKE AND EXHAUST VENTS

Double Vent (DVG-200) c/w extruded aluminum grilles

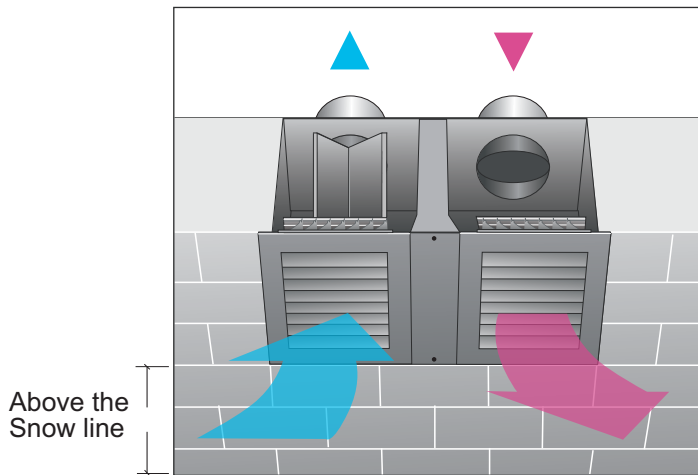


Front View



Side View

Tested @ 400Pa according to ASTM E547-00 for water penetration test.
Re-circulation Efficiency - 98% at 100 CFM.
(Tested @ 5 - 10mph wind velocity with Reversomatic Extruded Aluminum Grille) 50% free area.

Note: All Exhaust Vents must be installed min. 5 ft away from sidewalls.

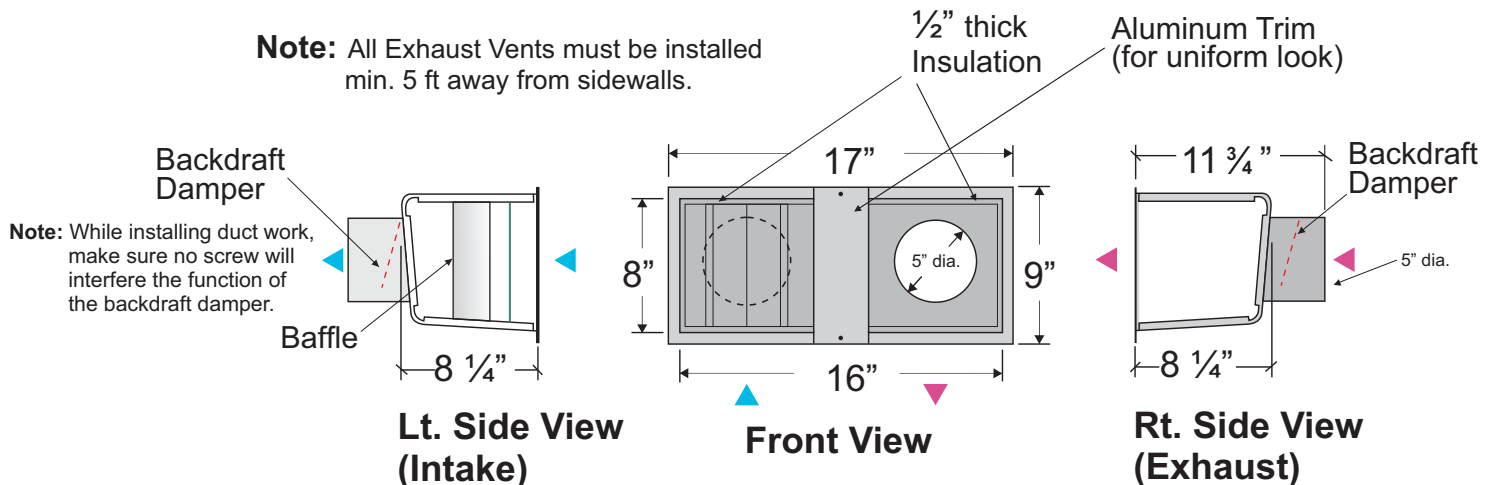

Contractor:		Double Vent (DVG-200)		
Architect:	Job:	Date	Supersedes	Drawing No.
Engineer:	Date Submitted:	01/16/19		

Reversomatic Manufacturing Ltd.



790 Rowntree Dairy Road, Woodbridge, ON, Canada L4L 5V3 • Tel: 905-851-6701 • Fax: 905-851-8376
www.reversomatic.com • info@reversomatic.com



REVERSOMATIC
MANUFACTURING LIMITED


HRV/ERV INTAKE AND EXHAUST VENTS

Exhaust (SVE-50) & Intake (SVI-50) Single Vents c/w extruded aluminum grilles

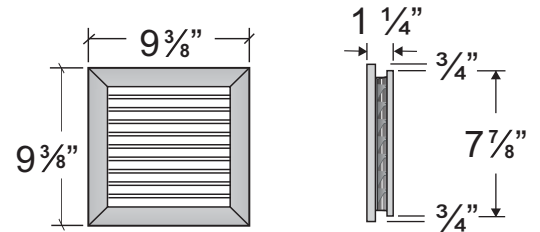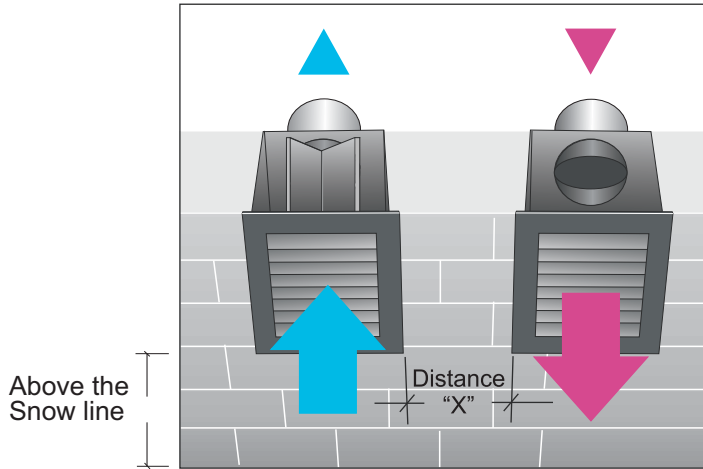

Front View

Side View

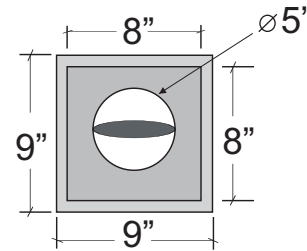


Back View


**Tested @ 400Pa according to
ASTM E547-00 for water penetration test.
Re-circulation Efficiency If distance
"X" is 5ft - 97.5% "X" is 3ft - 95% at 100 CFM.
(Tested @ 5-10 mph wind velocity with
Reversomatic Extruded Aluminum Grille)**

Intake Vent (SVI-50)

Side View:

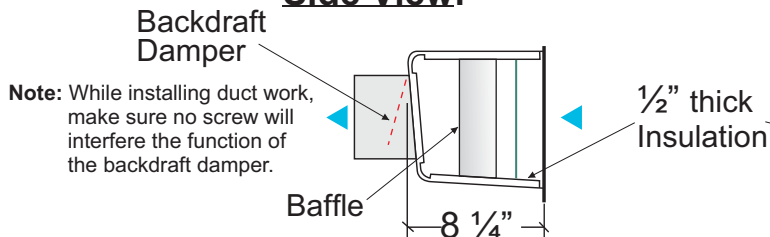

Exhaust Vent (SVE-50)

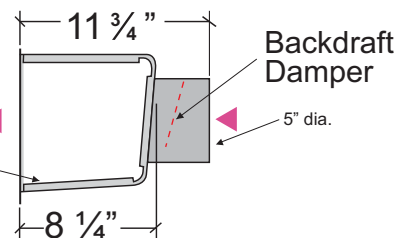

Contractor:		SVE-50 and SVI-50		
Architect:	Job:	Date	Supersedes	Drawing No.
Engineer:	Date Submitted:	01/16/19		

Reversomatic Manufacturing Ltd.


790 Rowntree Dairy Road, Woodbridge, ON, Canada L4L 5V3 • Tel: 905-851-6701 • Fax: 905-851-8376
www.reversomatic.com • info@reversomatic.com




REVERSOMATIC
MANUFACTURING LIMITED

HRV/ERV INTAKE AND EXHAUST VENTS

**Double vent (DVS-100) c/w
Side Exhaust / Intake hood**

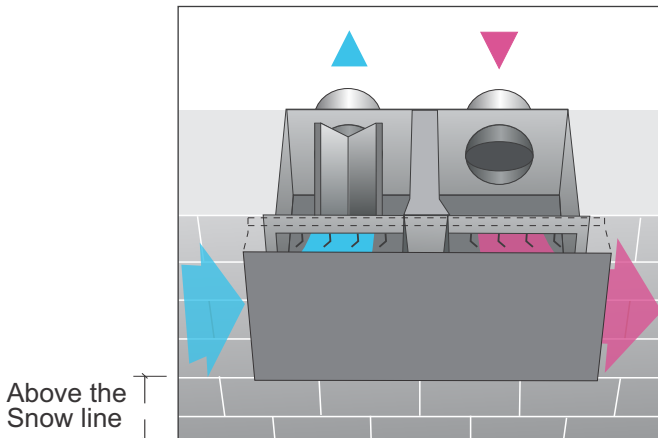


**Double vent (DVV-100) c/w
Vertical Exhaust / Intake hood**

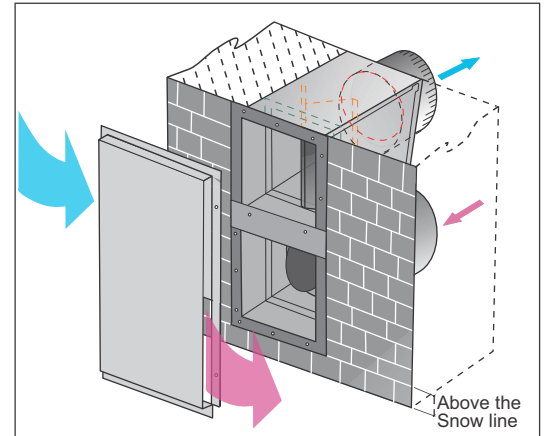



Tested @ 400Pa according to ASTM E547-00 for water penetration test.

**Re-circulation Efficiency - 96.5% at 100 CFM.
@ 5-10 mph wind velocity with
Reversomatic hood as shown.**

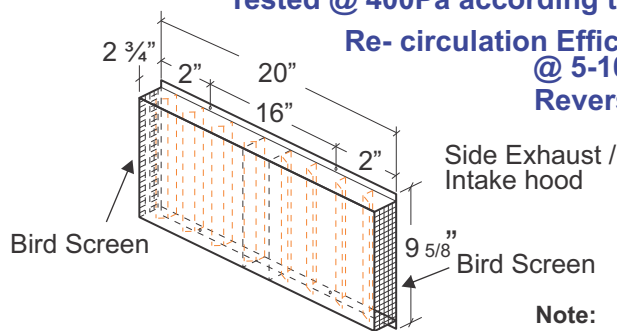


Note:
While installing duct work, make sure no screw
will interfere the function of the backdraft damper.

Exhaust / Intake hood
Plain Aluminum finish
(Custom colors available
upon request)

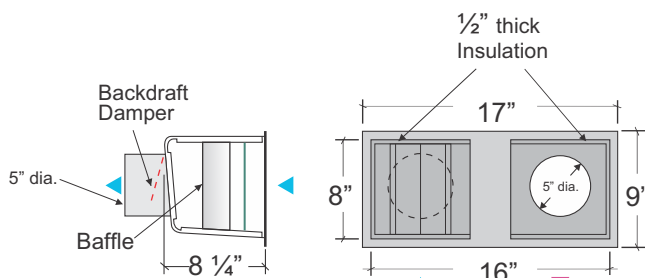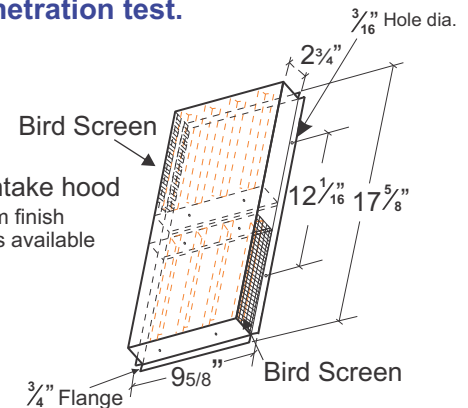


**Lt. Side View
(Intake)**


Front View



**Rt. Side View
(Exhaust)**

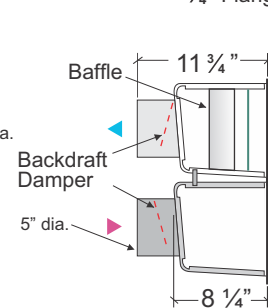

Side View

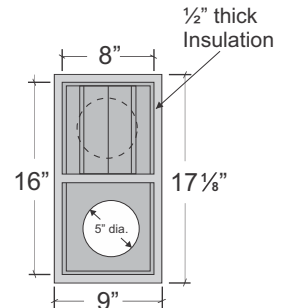

Front View

Note: All Exhaust Vents must be installed min. 5 ft away from sidewalls.

Contractor:	Double Vent (DVS / DVV-100)			
Architect:	Job:	Date	Supersedes	Drawing No.
Engineer:	Date Submitted:	01/16/19		

Reversomatic Manufacturing Ltd.


790 Rowntree Dairy Road, Woodbridge, ON, Canada L4L 5V3 • Tel: 905-851-6701 • Fax: 905-851-8376
www.reversomatic.com • info@reversomatic.com



REVERSOMATIC


MANUFACTURING LIMITED

HRV/ERV INTAKE AND EXHAUST VENTS

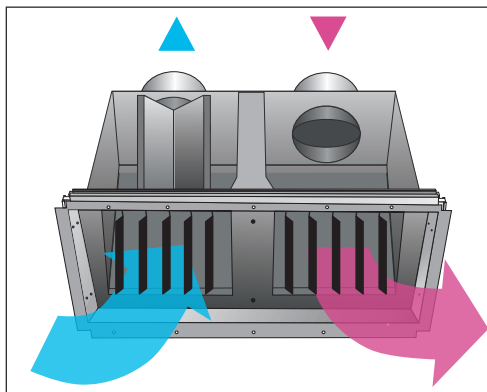


Tested @ 400Pa according to ASTM E547-00 for water penetration test.
Re-circulation Efficiency - 98.5% at 100 CFM.
(Tested with Reversomatic louver grille @ 5-10 mph wind velocity) 50% free area.

Double Vent (DV-200) For Window Panel

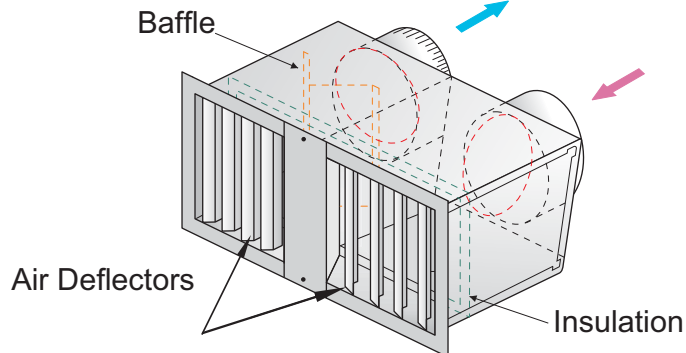

Note: All Exhaust Vents must be installed min. 5 ft away from sidewalls.

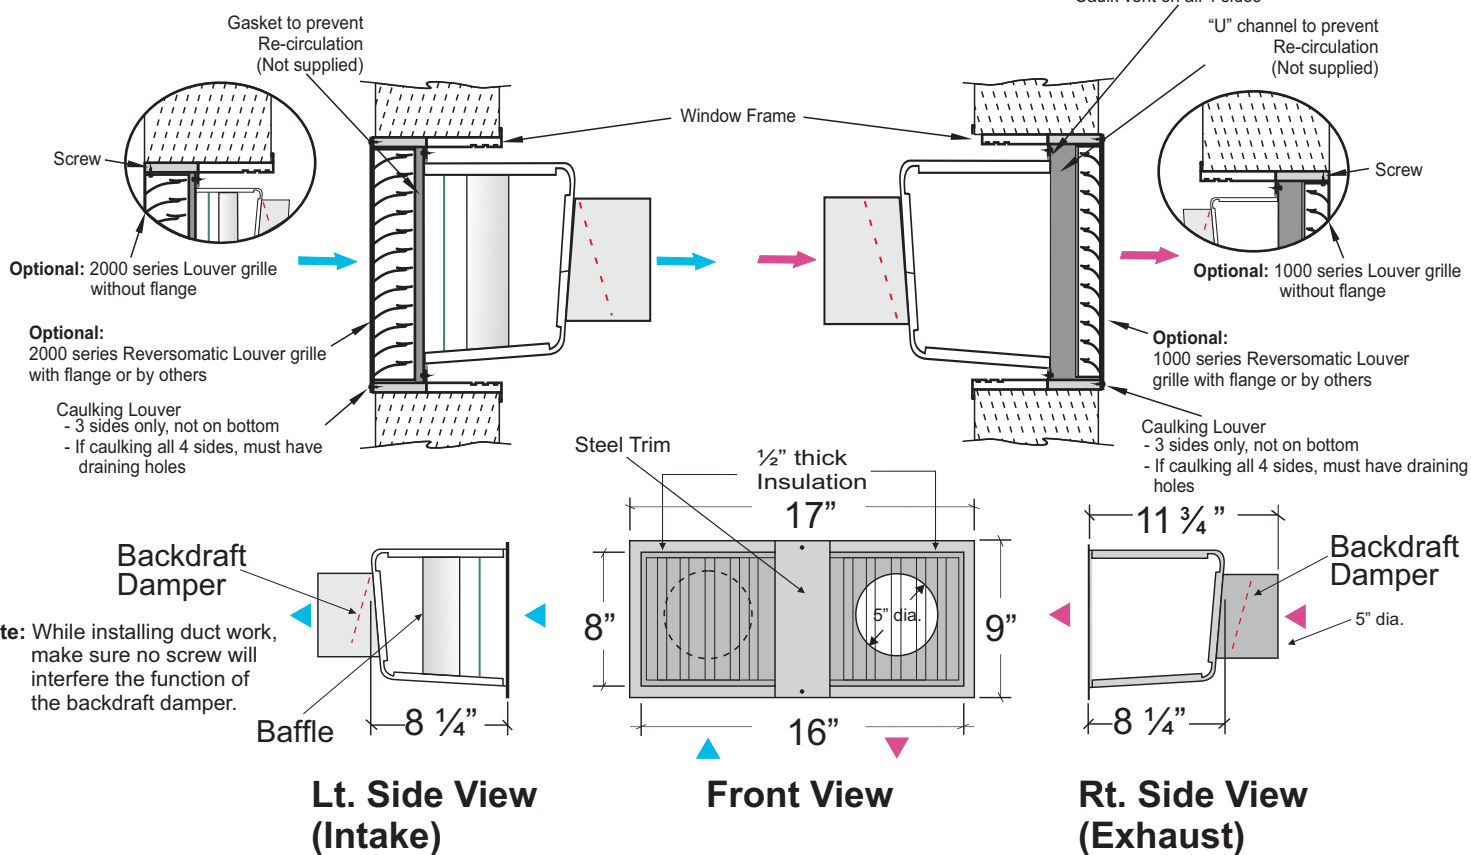

Contractor:		Double Vent (DV-200)		
Architect:	Job:	Date	Supersedes	Drawing No.
Engineer:	Date Submitted:	01/16/19		

Reversomatic Manufacturing Ltd.

790 Rowntree Dairy Road, Woodbridge, ON, Canada L4L 5V3 • Tel: 905-851-6701 • Fax: 905-851-8376
www.reversomatic.com • info@reversomatic.com