

Shop Drawing RHRV-C100A

HRV Compact Unit (Aluminum Core)


Plastic backdraft damper 5" dia.


Features

- Over all size 20" (W) x 21" (D) x 9" (H), App. weight 32 lbs.
- Power ratings: 115V/1/60 Hz, 0.70 Amp.
- Washable Aluminum Core
- High efficiency energy saving permanently lubricated variable speed PSC motors for air balancing
- Furnace / Fan-coil / Heat Pump Interlock
- Dual Protection: If the exhaust fan fails, the outside fresh-air supply will be closed by shutting off the supply motor and the relay contact for motorized damper and interlock will be opened. Fan Coil/Furnace low speed will be stopped and at normal operation no air will enter into the system
- Automatic non-recirculating defrost
- Washable MERV 3/4 filters
- Tilted core design
- continuous fresh air supply up to 80 CFM
- Ideal for horizontal and vertical installation
- 4 mounting brackets and 2 drain plugs are included
- Exhaust up to two washrooms


OPTIONAL ACCESSORIES:

- Push button Timer Switches (5VDC)
- Time Delay Switch (120VAC)
- Intermittent Switch (5VDC) (See on Back side)
- Dehumidistat
- Motorized spring return damper (Option 1 or 2)
- Adjustable mounting straps or chain mounting system

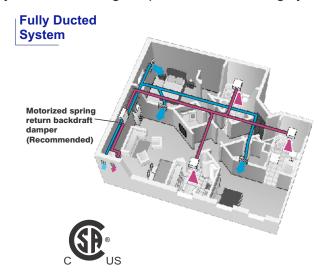

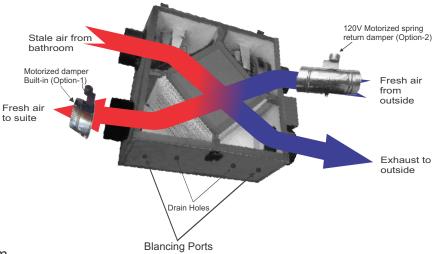


9"

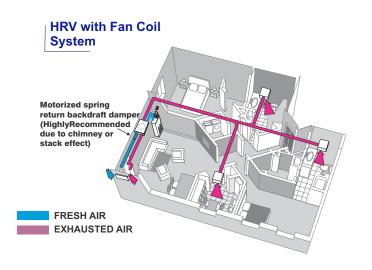


FRESH AIR

EXHAUSTED AIR

Installation Options for High-Rise Condominium

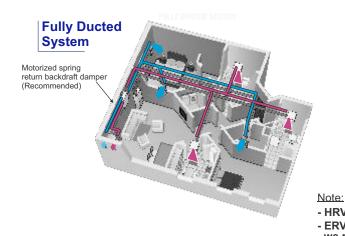

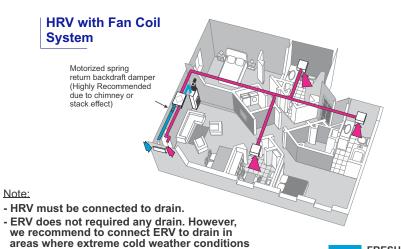

VENTILATION PERFORMANCE

Model #	Normal Speed Supply/Exhaust (Constant Ventilation) @ 50 Pa	High Speed Exhaust (Activated by switch) @ 50 Pa	Maximum Power Rating 120V / 1 / 60Hz	
RHRV-C100A	20 ~ 80 CFM variable	70 ~ 115 CFM variable	0.70 Amp.	

^{*} Normal / High Speed and air-flow balancing can be achieved by adjusting speed controller knob located on the main controller.


ENERGY PERFORMANCE

are expected.

RHR'	-		Supply emperature		let flow	Supply / Exhaust	Average Power	Sensible Revcovery	Apparent Sensible	Net Moisture
C 100	IA .	°C	°F	L/S	CFM	Flow Ratio	(Watts)	Efficiency	Effectiveness	Transfer
	i	0	32	30	64	1.03	70	58	70	2 %
Heating	ii	0	32	36	77	1.02	84	56	67	2 %
Hea	iii	0	32	43	91	1.02	100	55	65	3 %
	iv	-25	-13	30	64	0.96*	75	60	72	2 %

^{*} The Supply / Exhaust Flow Ratio at 22°C to the start of the 72 Hour Cold Weather Test

ACCESSORIES

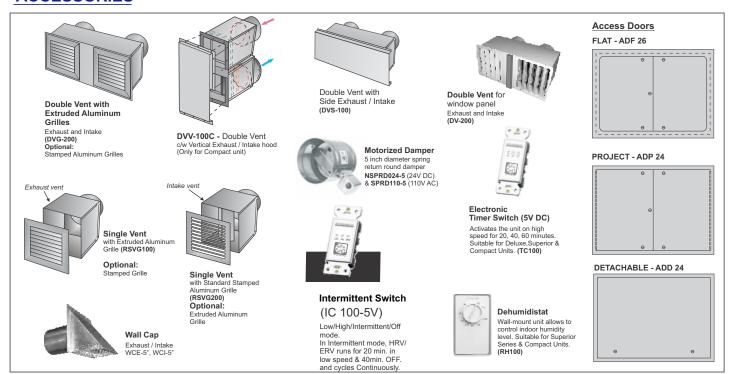

Contractor:			RHRV-C100A		
Architect:	Job:	Date	Superse.des	Drawing No.	
Engineer:	Date Submitted:	11/15/2016			